

**Thank you for choosing a NIVELCO instrument.
We are sure that you will be satisfied throughout its use!**

1. APPLICATION

The conductive measuring principle can be applied to liquids with specific conductivity over 10 µS/cm. The switching unit can sense the resistance between probes. Conductivity measurement is suitable only for detecting the presence of liquid at a given level of the tank. This level is represented by the length of the probe.

The level switch consists of a **NIVOCONT KRK-522-□** type switching unit and the **KLN-2□□** type probes selected according to the task. Probes are to be connected to the **NIVOCONT KS□-20** type probe socket head that can be screwed into the tank. If the material of the tank or its internal insulation is not conductive then a reference probe should be used in addition to the one, two, three or four probe(s), if the material of the tank is conductive, the tank can be used as a reference probe.

The conductive switch is suitable for filling-emptying control with 2 relay outputs working simultaneously or for level detection of 2 independent levels (in 1 or 2 tanks) with 2 independent relay outputs.

2. TECHNICAL DATA

2.1 GENERAL DATA

2.1.1 TECHNICAL DATA OF THE SWITCHING UNIT

Type	KRK-522-□	
Probe voltage	5 V AC	
Probe current	< 1 mA AC	
Sensitivity	Adjustable: 5 kΩ ... 100 kΩ	
Max. cable capacity	4 nF	
Response	max. 400 ms	
Setting accuracy (mech.)	± 5 %	
ON / OFF switching delay	Adjustable: 0.5 ... 10 s	
Relay output	2x SPDT	
Switching voltage	250 V AC1, 24 V DC	
Switching current	16 A AC1	
Switching power	4000 VA AC1, 384 W DC	
Electrical strength	4 kV	
Mechanical life-span	3 x 10 ⁷ switches	
Electrical life-span	0.7x10 ⁶ switches	
Power supply U _n	110, 230 V AC	24 V AC/DC
Voltage range allowed	nominal voltage - 15% ... +10%	
Power consumption	max 4.5 VA	
Ambient temperature	-20 °C ... +55 °C	
Electrical connection	max. 2.5 mm ² / with insulation 1.5 mm ²	
Electrical protection	class II	class III
Ingress protection	IP 20	
Mechanical connection	DIN EN 60715 rail	
Mass	240 g	

2.1.2 TECHNICAL DATA OF PROBE SOCKETS

Type	KSK-201	KSP-201	KSS-201	KSN-201	KSH-202	KSH-203	KSH-204	KLN-2□□
Nr. of probes	1			2 probes + 1 ref. probe	3 probes + 1 ref. probe	4 probes + 1 ref. probe	1	
Insulation of socket	ABS	PP	PFA			—		
Cable gland	Pg 9	M4 nut rubber cap protected			M20x1.5 cable diameter 6 ... 12 mm	—		
Process connection	—	3/8" BSP			1 1/2" BSP	M6		
Socket material	—	PP	A44 steel	KO35 stainless steel (1.4571)				
Housing material	—			Paint coated aluminium cast				
Medium temperature	max 80°C			max 200°C				
Max. pressure	—	0.3 MPa	1.6 MPa			—		
Ingress protection	—	IP 20			IP 65		—	
Mass	0.05 kg	0.1 kg			0.4 kg		0.22 kg/m	

2.2 ORDER CODES

NIVOCONT KRK-522-□

NIVOCONT KS□-20□

Power supply	Code
230V AC	1
110V AC	2
24V AC/DC	4

Type	Code	Probes	Code
Cable probe	K	1 no	1
Single probe, PP socket	P	2 nos + reference probe	2
Single probe, steel socket	S	3 nos + reference probe	3
Single probe, st. steel socket	N	4 nos + reference probe	4
Multiple probes, st. steel socket	H		

NIVOCONT KLN-2□□

Probe length*	Code
0.5m ... 3m	05...30

* to be ordered in 0.5 m units

NIVOCONT KLP-204 Probe separator

2.3 ACCESSORIES

- User's manual
- Warranty Card
- Declaration of conformity
- Sealing (2 mm thick) (KLINGER OILIT):
 - 1 pc. 3/8" (for KSP-201, KSS-201, KSN-201)
 - 1 pc. 1 1/2" for a KSH-20_
- M6 nut (standard SW):
 - 3 pcs. for KSH-202
 - 4 pcs. for KSH-203, KSH-204
- M6 nut (non-st. SW): 1pc. for KSH-204


NIVOCONT

KRK-522 CONDUCTIVE LEVEL SWITCH



USER'S MANUAL




2.4 DIMENSIONS

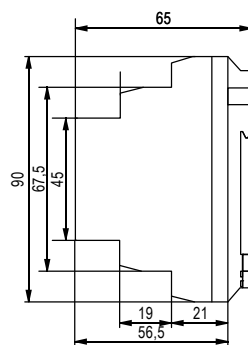


KRK-522-□ SWITCHING UNIT

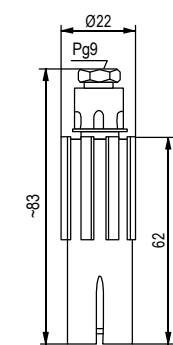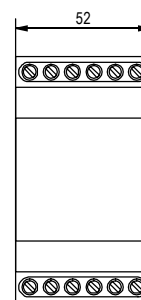


KSK-201 CABLE PROBE

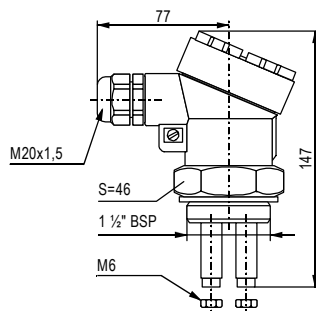


PROBE SOCKET KSH-20□

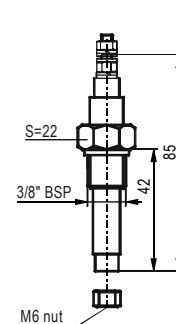

PROBE SOCKET KSP-201
KSS-201
KSN-201

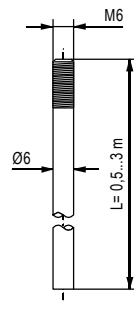

PROBE KLN-2□□

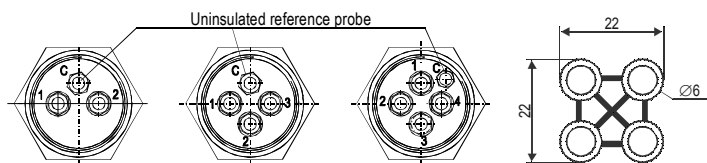

KSH-202

KSH-203

KSH-204

SEPARATOR KLP-204

3. INSTALLATION

KRK-522-□ switching unit can be mounted on DIN EN 60715 rail.

It is recommended that the KLN-2□□ type probes are cut to the length required for level detection on site. The probes should be screwed into the KS□-20□ type sockets.

ALWAYS REMEMBER TO TIGHTEN THE PROBE WITH AN M6 NUT!

When using KSH-204 type probe sockets the reference probes should be tightened with special SW hexagonal M6 nuts!

It is suggested that KLP-204 type PVDF separators (suitable up to 130°C) be used at every 0.5m for multiple probe devices to keep the probes apart.

A KSK-201 single probe, attached to an insulated cable, can be lowered into pits and wells without running the risk of a short circuit. When a measurement is needed in a well or in a plastic pipe 2 of them have to be used.

